


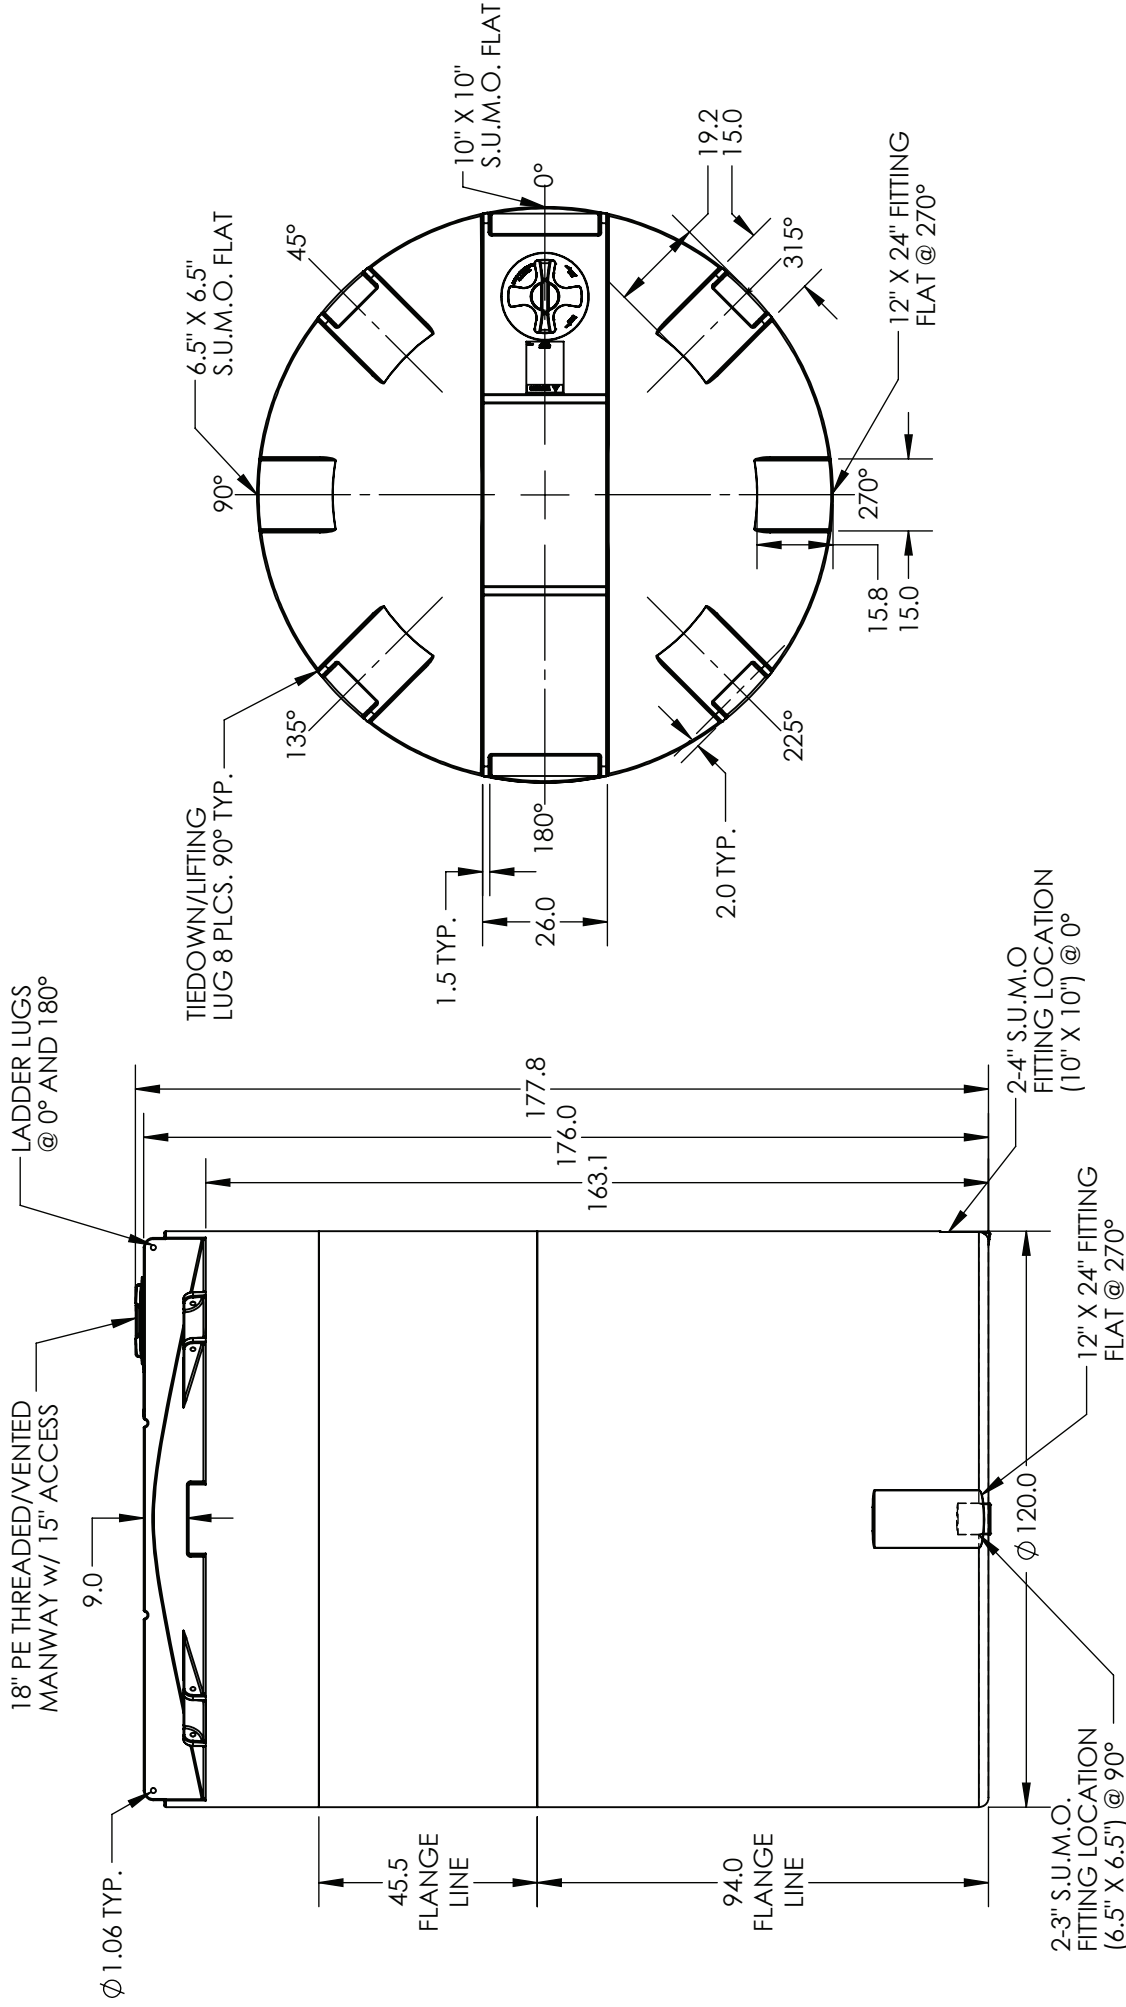

*ALL EXTERNAL PIPING MUST BE INDEPENDENTLY SUPPORTED.
 *ONLY BASE FITTINGS TO BE LEFT INSTALLED AT TIME OF SHIPMENT PER SII PROCEDURE.
 *TANKS ORDERED WITH FOAM INSULATION WILL HAVE AN INCREASED DIAMETER OF 4-6 INCHES.
 *Consult Snyder's Guidelines for Use and Installation prior to delivery.
 Available on-line at <http://www.snyderindustriestanks.com/Technical>
 ALL DIMENSIONS ARE IN INCHES. NOMINAL. & SUBJECT TO CHANGE WITHOUT NOTICE.
 ALL DIMENSIONS ON ROTATIONAL MOLDED PARTS ARE SUBJECT TO A ± 3% TOLERANCE.

STATUS:	DO NOT SCALE	DRAWN BY ET3	TITLE: 	REVISION B	
				SHEET 1 OF 1	
Released			PART NO. 7370000N__01		BKG. ID. D001046
© SNYDER INDUSTRIES, LLC, 2019					
ALL DIMENSIONS, DESIGNS, AND INFORMATION ON THIS PRINT ARE TO BE CONSIDERED PRELIMINARY. TO SNYDER INDUSTRIES, LLC, AND MAY NOT BE USED, COPIED, OR DISTRIBUTED WITHOUT WRITTEN PERMISSION OF AN OFFICER (OR HIS AGENT) OF THE FIRM.					
(402) 467-5221 www.snyderind.net.com					